

# Manual 3, Revision 58 Transmission Operations Periodic Review

Lagy Mathew
Sr. Engineer, Transmission Operations, PJM
Operating Committee
October 08, 2020

www.pjm.com | Public PJM©2020




- Periodic Review. Updated references to Manual-03B throughout.
- 3.3.1 Voltage Limit Exception Corrected 138kV PJM baseline limit
- Section 1, 3 and 4: Updated EHV reference by defining EHV and removed duplicate uses.

www.pjm.com | Public 2 PJM©2020



## M-03, Rev. 58 – Review/Approval Timeline

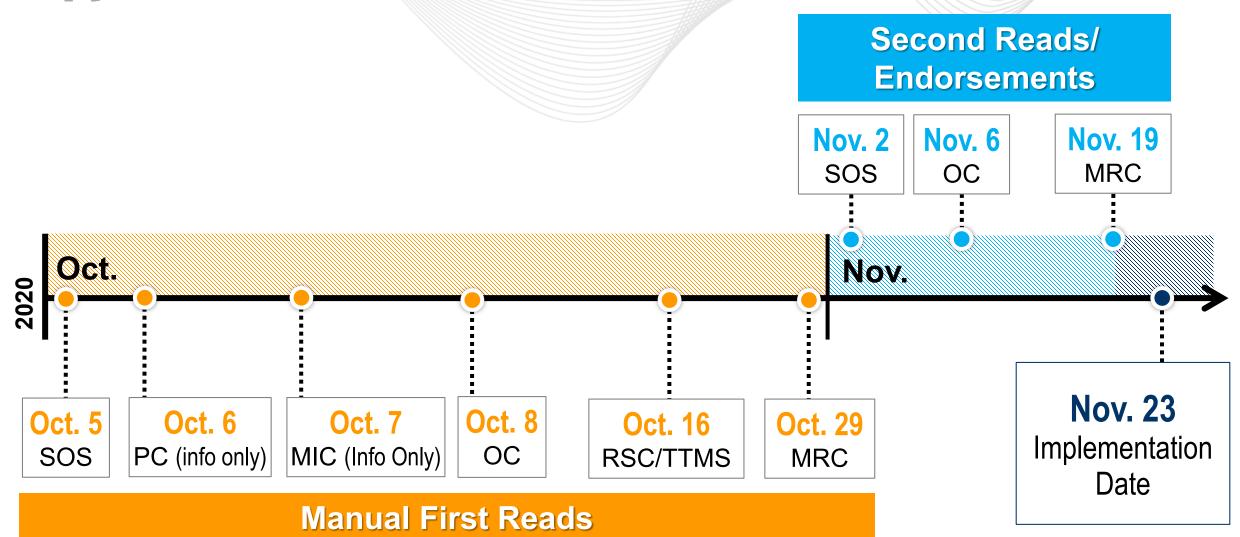



## **SME/Presenter:**

Lagy Mathew, Lagy.Mathew@pjm.com

Manual 03, Rev 58 – Periodic Review



## Member Hotline

(610) 666 - 8980

(866) 400 - 8980

custsvc@pjm.com



## **Appendix**

www.pjm.com | Public PJM©2020



#### Revision 57.1 (06/11/2020):

- DOM: Removed Marsh Run and Remington CT Stability Procedure due to system topology changes.
- DOM: Removed South Anna and Louisa CT Islanding Scheme procedure due to system topology changes.
- FE-East: Updated circuit breaker names for the Homer City Stability Trip Procedure.
- FE-East: Added new Homer City Runback Procedure (OM-55).

## • Revision 57.2 (07/16/2020):

- FE East: Updated Homer City RAS procedure with additional scheme position.
- PPL: Updated the Wescosville 500/138 T3 Transformer Switching procedure to indicate the Wescosville T5 is normally open for contingency control.
- BGE: Updated the Calvert Cliffs-Chalk Point line number from 5071 to 5072

www.pjm.com | Public PJM©2020



## Revision 57.3 (09/30/2020):

- PPL: Updated NEPA stability procedure to include restrictions for the Lackawanna-Hopatcong outage.
- PE: Added table to the Peach Bottom Transformer Outage procedure to clarify restrictions.
- DOM: Updated Circuit Breaker reference from 230 kV to 500 kV for the Clover procedure.
- FE-East: Updated Conemaugh/Hunterstown/Fairview Stability procedure to include breaker outage conditions.
- FE-East: Updated Seneca Stability procedure for outage of Erie West-Ashtabula 345kV line.
- FE-East: Updated Seneca Stability procedure to represent Seneca having maximum of 2 pumping units.
- ComEd: Added new Braidwood/LaSalle Stability procedure.

www.pim.com | Public 7 PJM©2020