




System Operations Report


Stephanie Monzon
Manager, Markets Coordination
Operating Committee
October 7, 2021


September 2021
 Hourly Error: **1.50%** Peak Error: **1.56%**

- All Hours
- Peak Hours Only
- Winter
- Summer
- 25-month Average
- 25-month Average

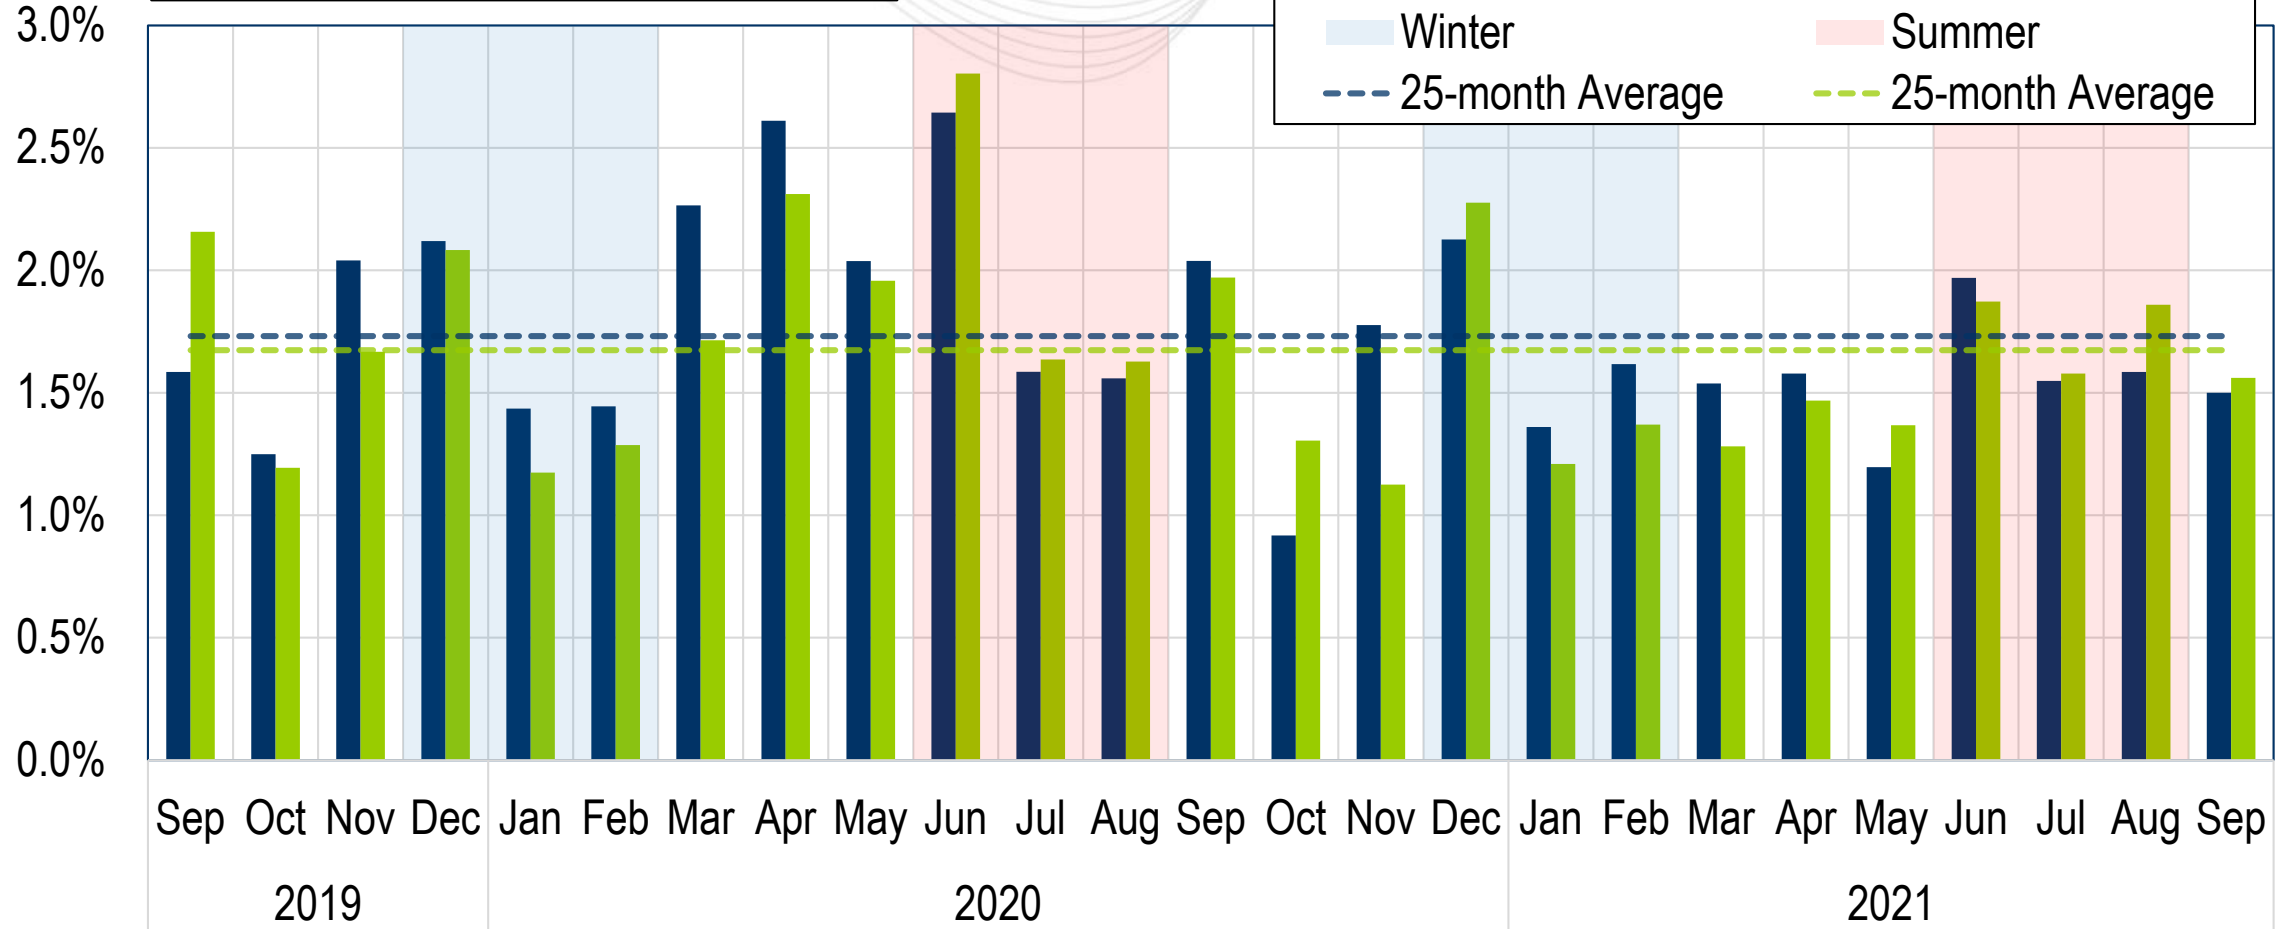

Daily Peak Forecast Error (September)


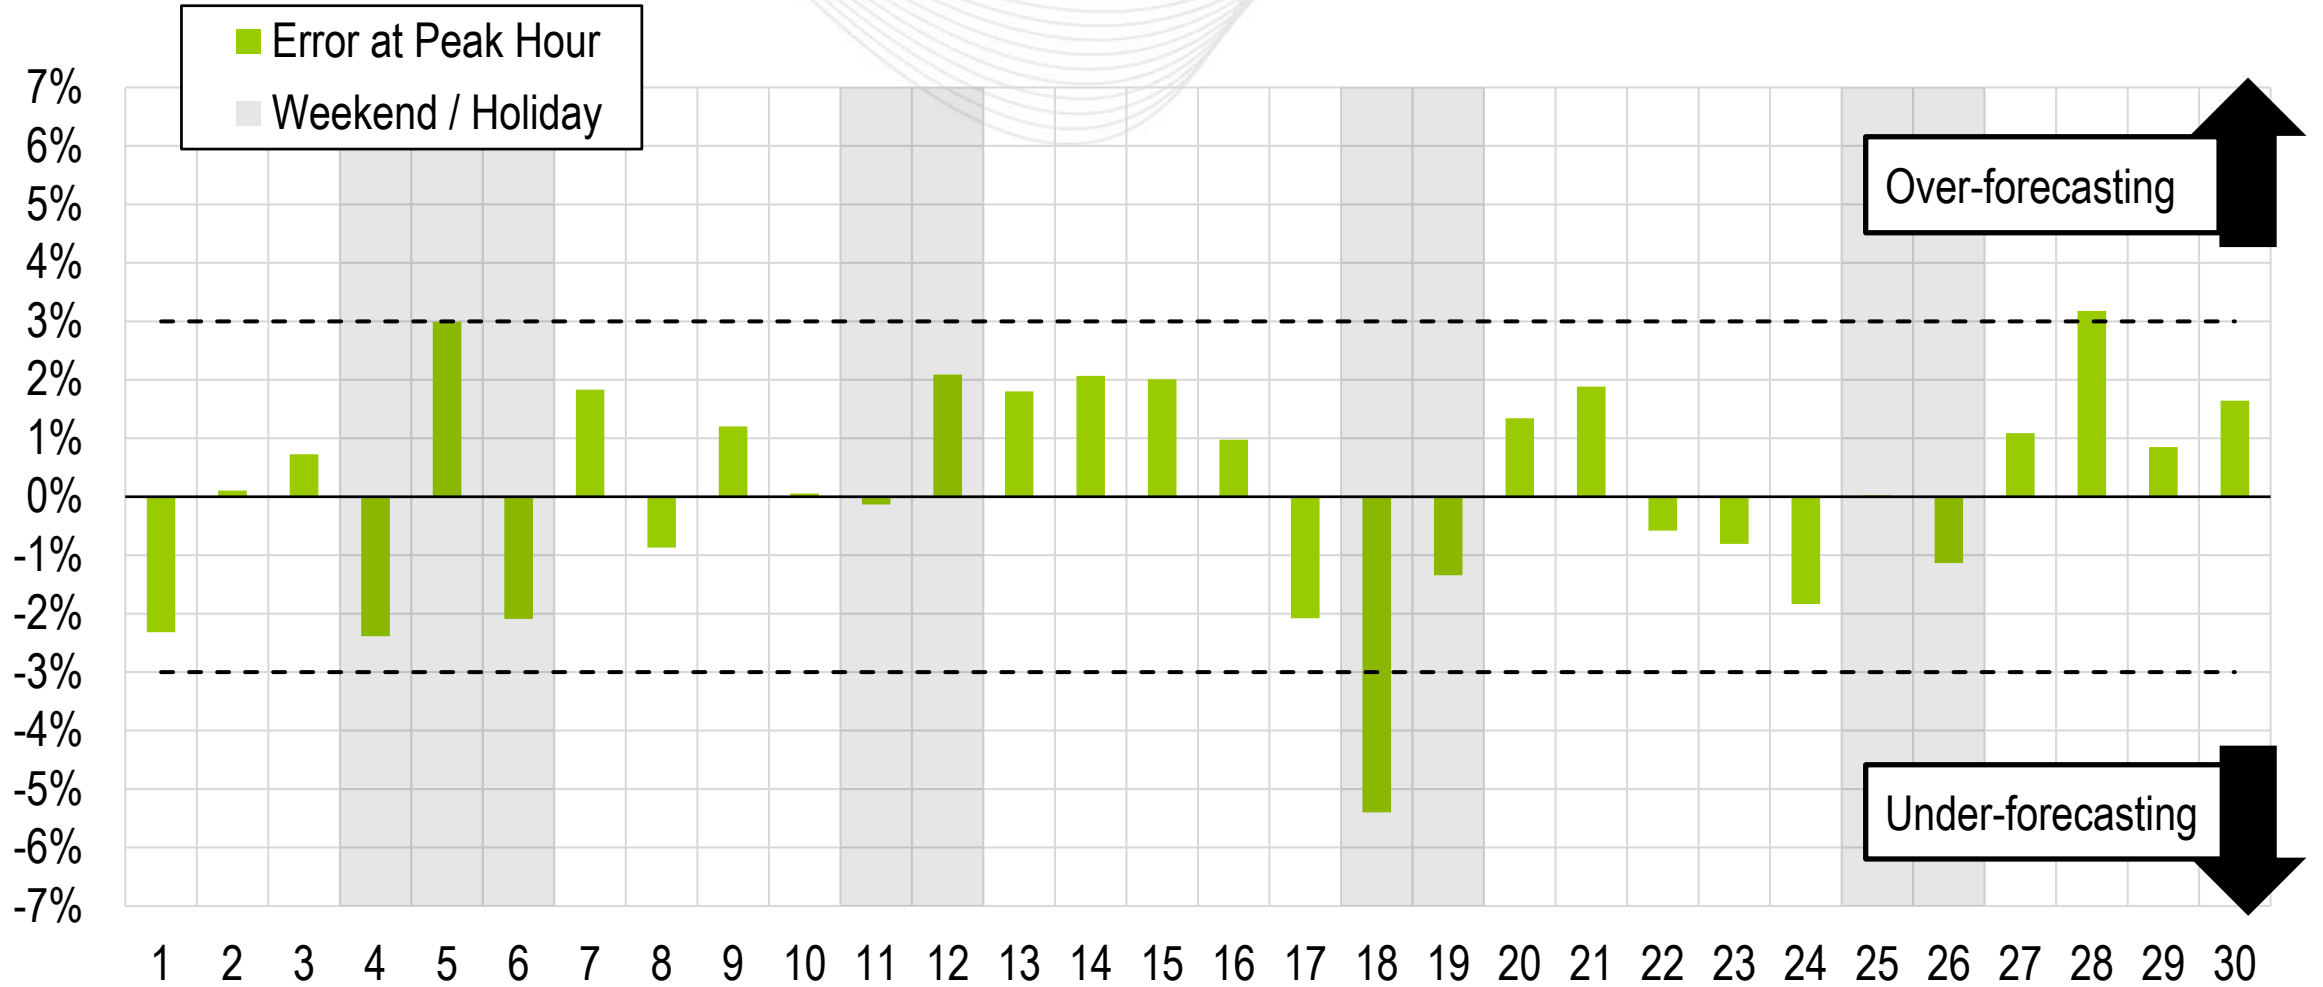


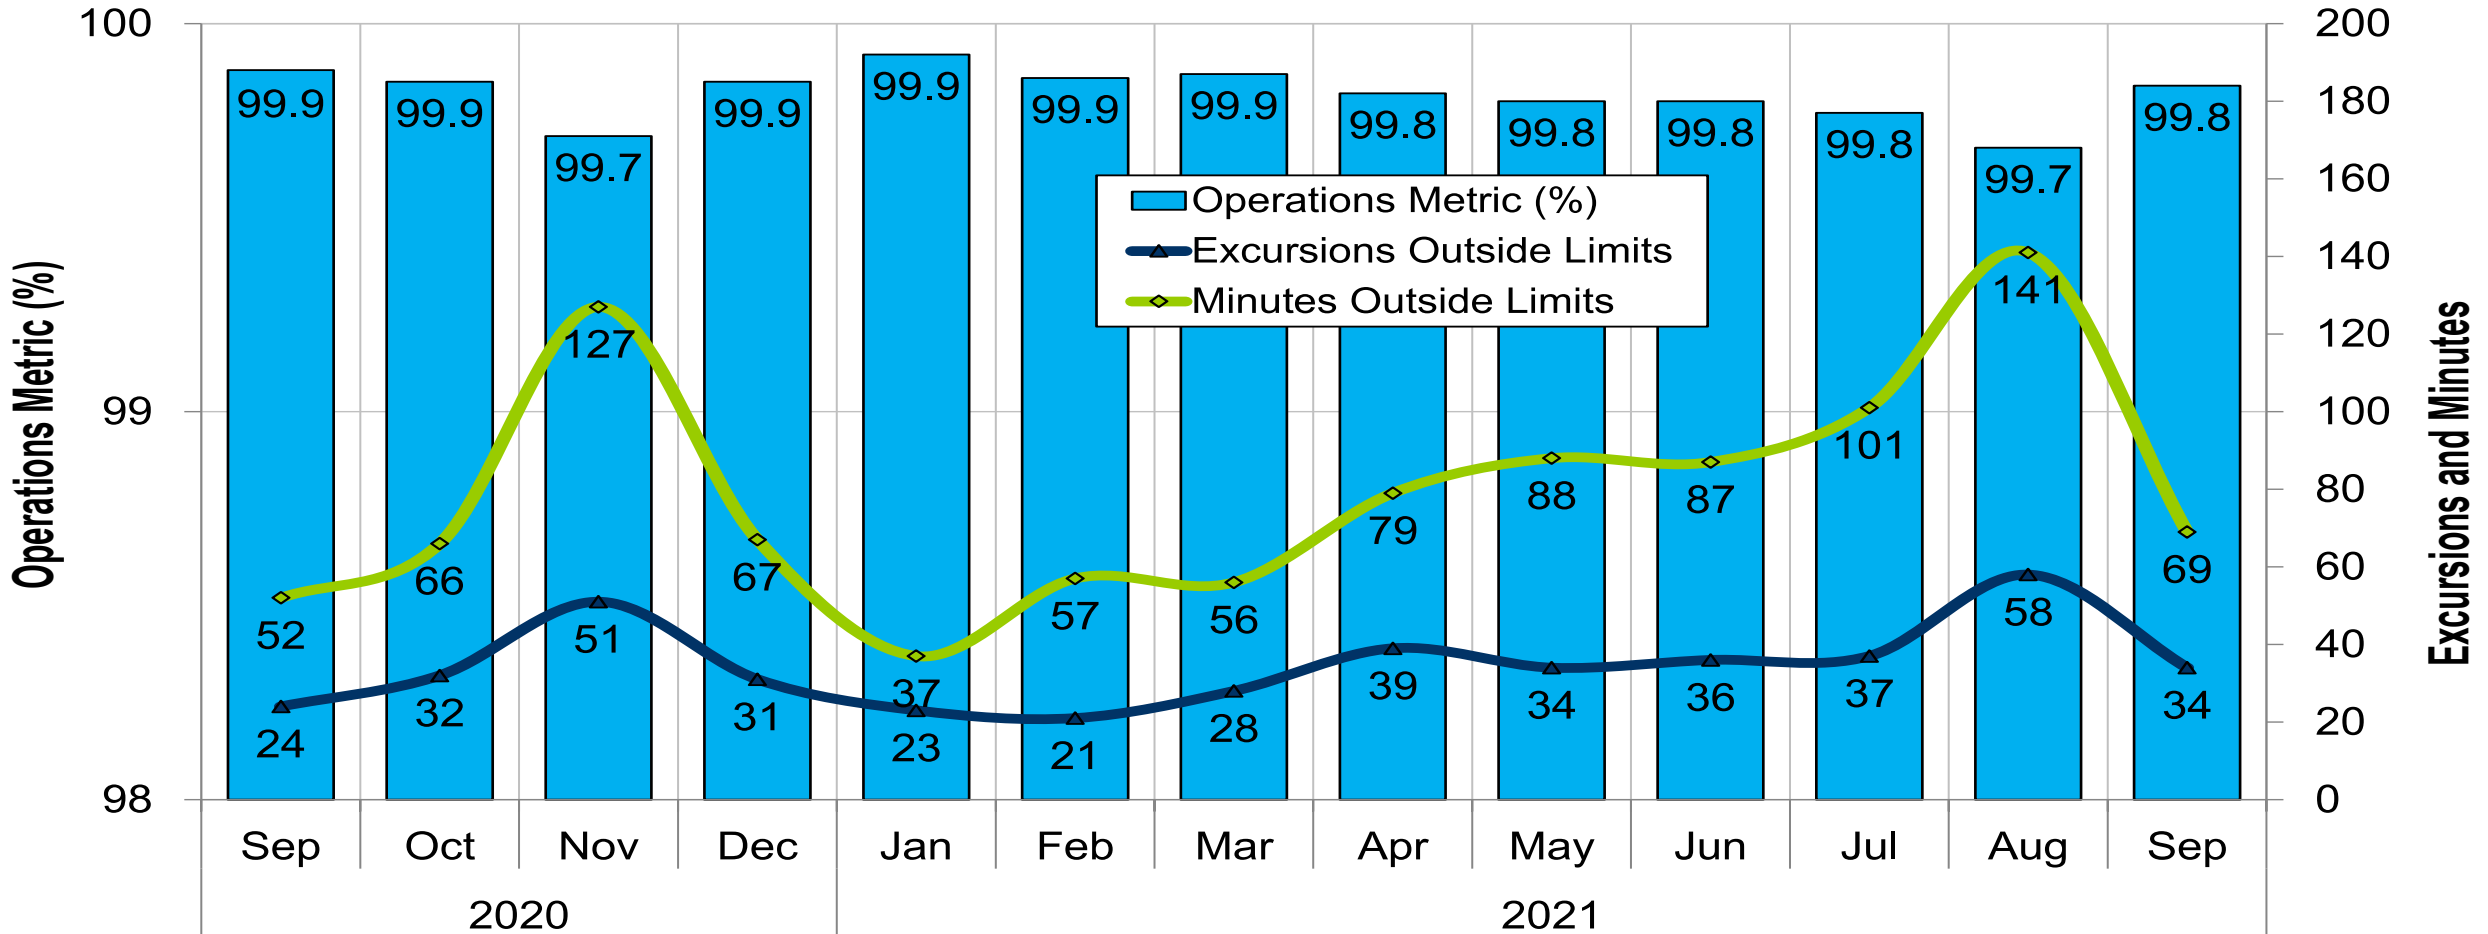

PJM's BAAL performance has exceeded the goal of 99% for each month in 2021.


- One spinning event
- Two reserve sharing events with the Northeast Power Coordinating Council (NPCC)
- The following Emergency Procedures occurred:
 - 12 Post-Contingency Local Load Relief Warnings (PCLLRW)
 - 2 Hot Weather Alerts
 - 4 High System Voltage
 - 1 Shortage Case Approved

- 1 Shortage Case Approved
- The approved Shortage Case occurred on:
 - 09/27/21:
 - 1 Shortage Case for 17:05
 - During peak load time, one large unit tripped

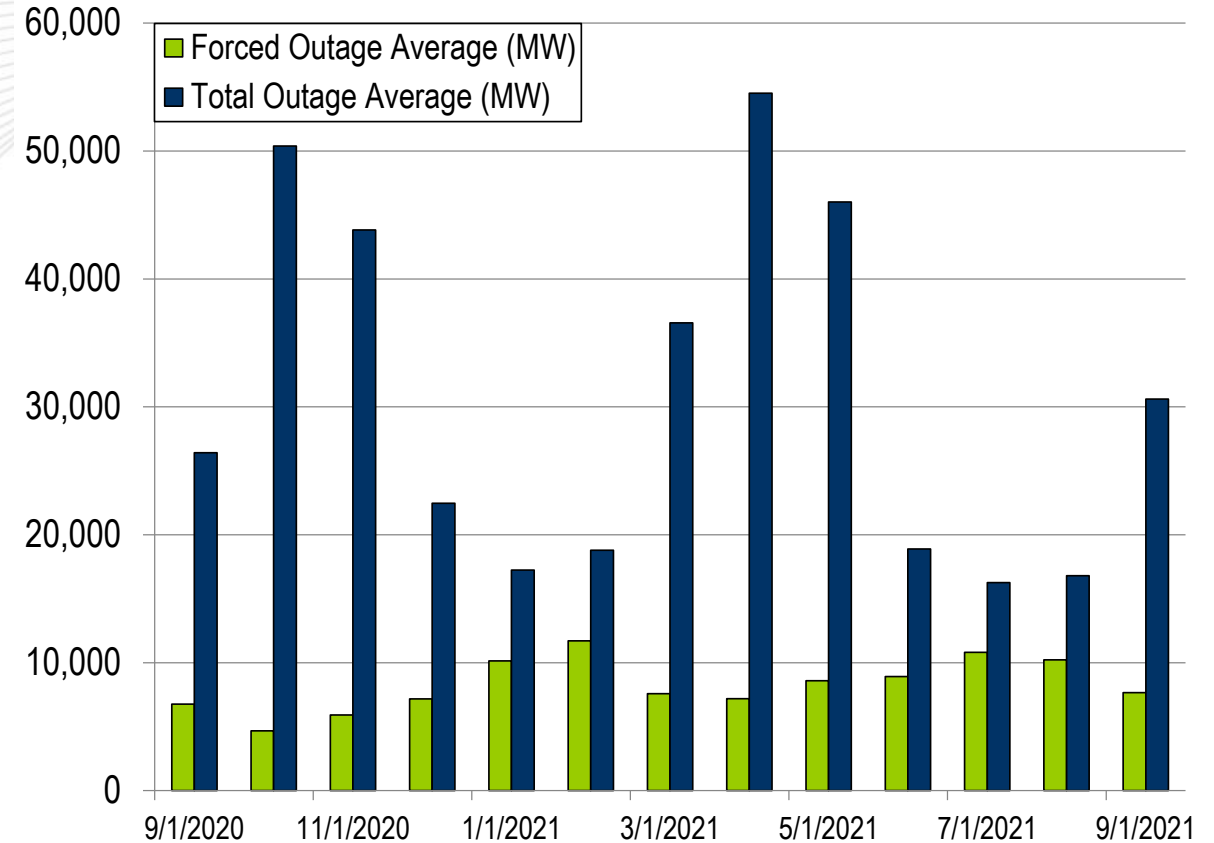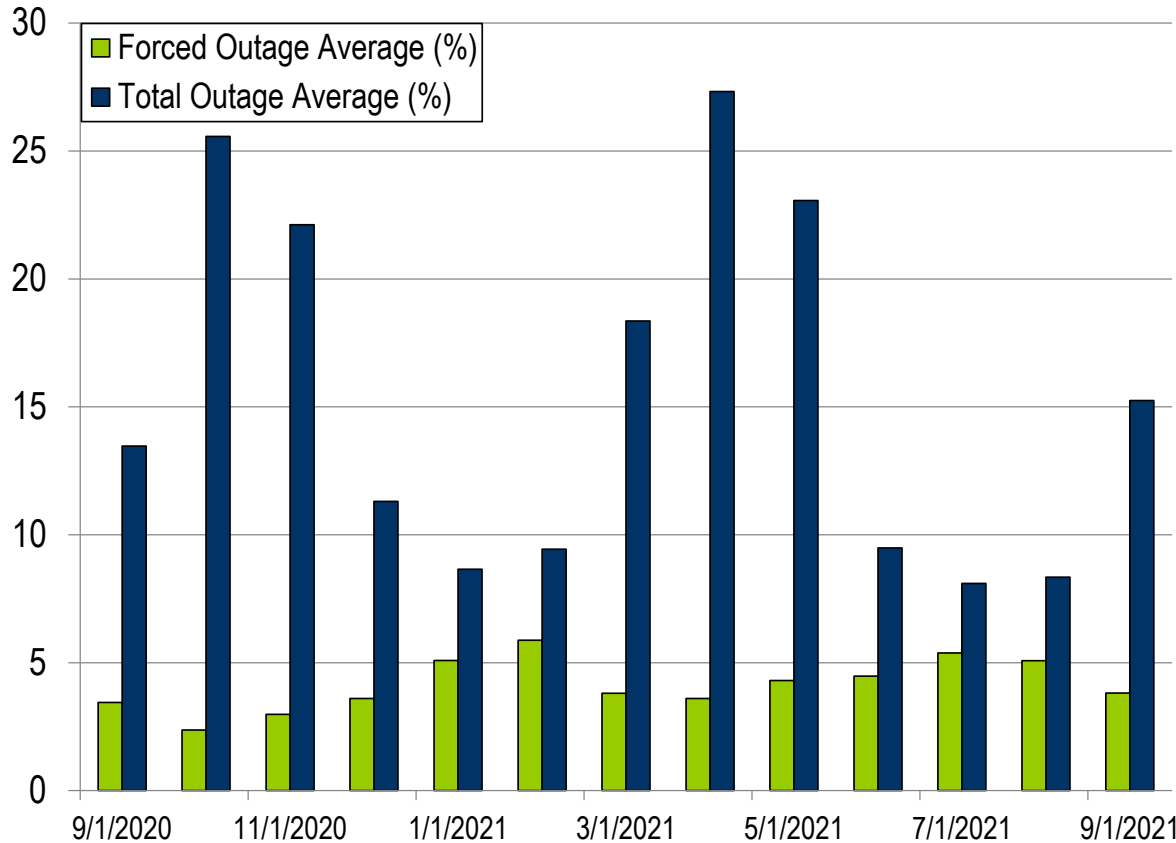


The 13-month average forced outage rate is 4.13% or 8,241 MW.
 The 13-month average total outage rate is 15.44% or 30,718 MW.

2020-2021 Planned Emergency, Unplanned, and Total Outages by Ticket

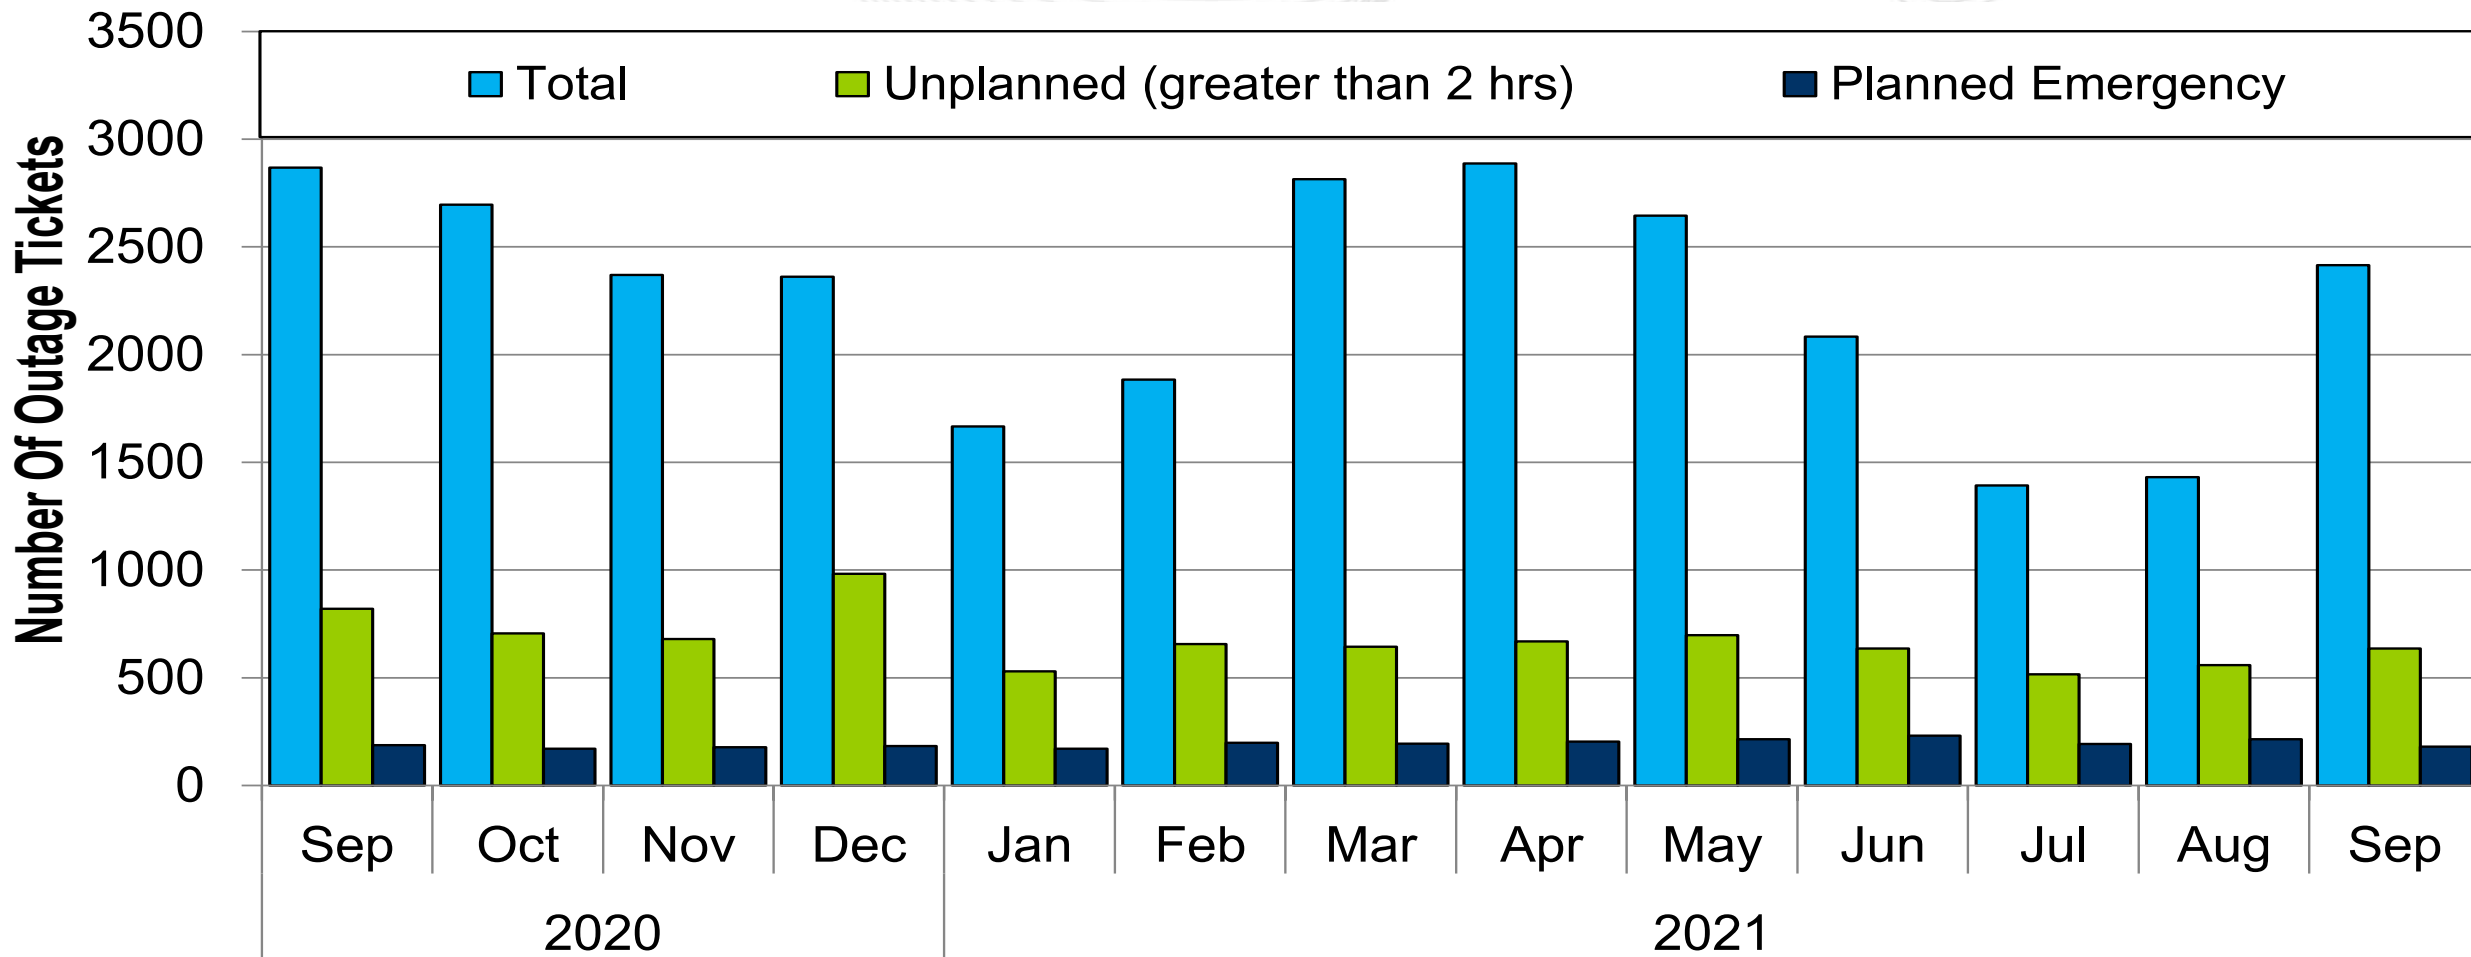

Note: "Unplanned Outages" include tripped facilities. One tripping event may involve multiple facilities.

PCLLRW Count Vs. Peak Load – Daily Values For 3 Months

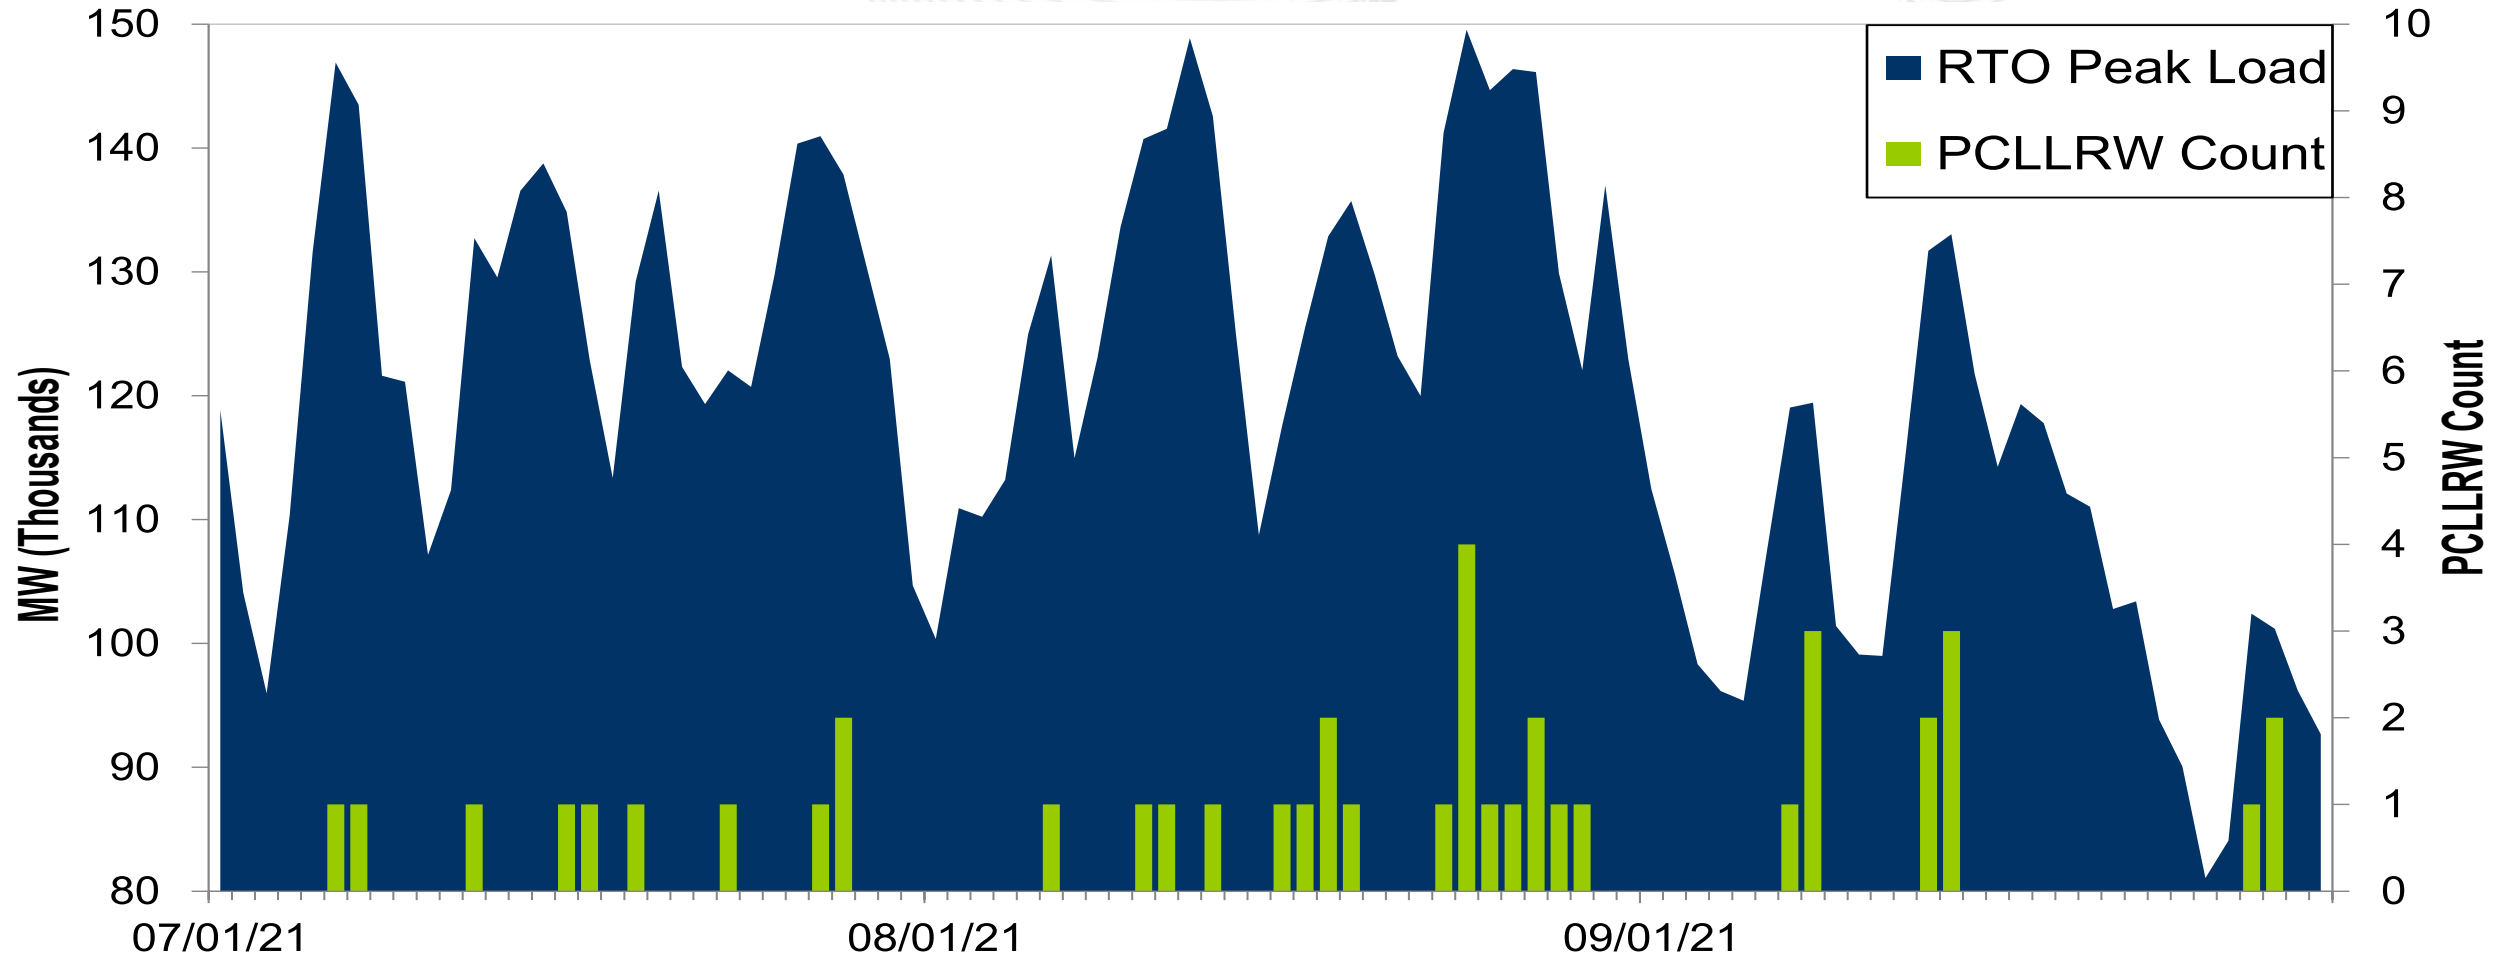

Event	Date	Start Time	End Time	Duration	Region	Tier 1 Estimate (MW)	Tier 1 Response (MW)
1	09/27/21	16:56:05	17:04:30	00:08:25	RTO	679.5	385.1



Event	Event	Event	End Time	Duration	Region	Tier 2 Assigned (MW)	Tier 2 Response (MW)	Tier 2 Penalty (MW)
1	09/27/21	16:56:05	17:04:30	00:08:25	RTO	1136.5	1136.5	0.0

*Tier 2 Response is equal to Tier 2 Assigned for events with duration less than ten minutes

Appendix


Goal Measurement: Balancing Authority ACE Limit (BAAL)

- The purpose of the new BAAL standard is to maintain interconnection frequency within a predefined frequency profile under all conditions (normal and abnormal), to prevent frequency-related instability, unplanned tripping of load or generation, or uncontrolled separation or cascading outages that adversely impact the reliability of the interconnection. NERC requires each balancing authority demonstrate real-time monitoring of ACE and interconnection frequency against associated limits and shall balance its resources and demands in real time so that its Reporting ACE does not exceed the BAAL ($BAAL_{LOW}$ or $BAAL_{HIGH}$) for a continuous time period greater than 30 minutes for each event.
- PJM directly measures the total number of BAAL excursions in minutes compared to the total number of minutes within a month. PJM has set a target value for this performance goal at 99% on a daily and monthly basis. In addition, current NERC rules limit the recovery period to no more than 30 minutes for a single event.

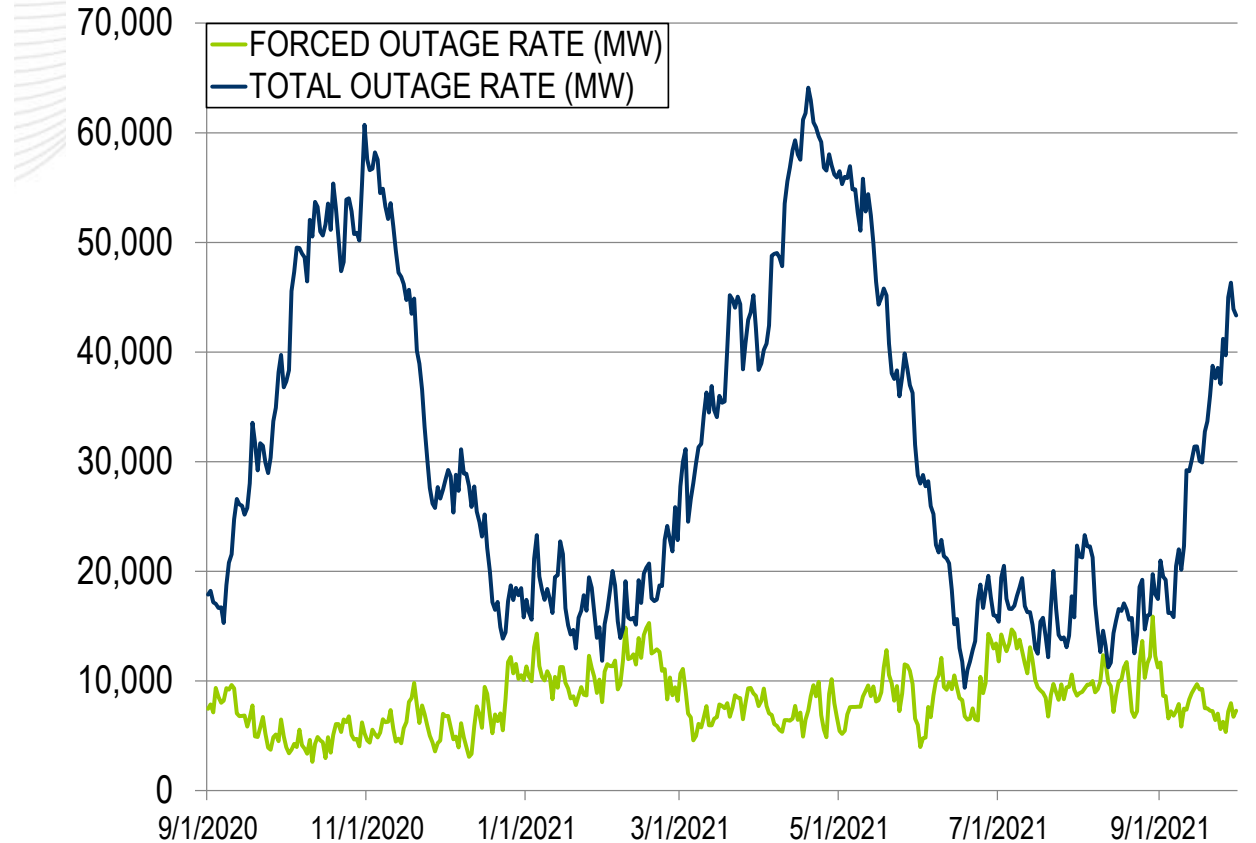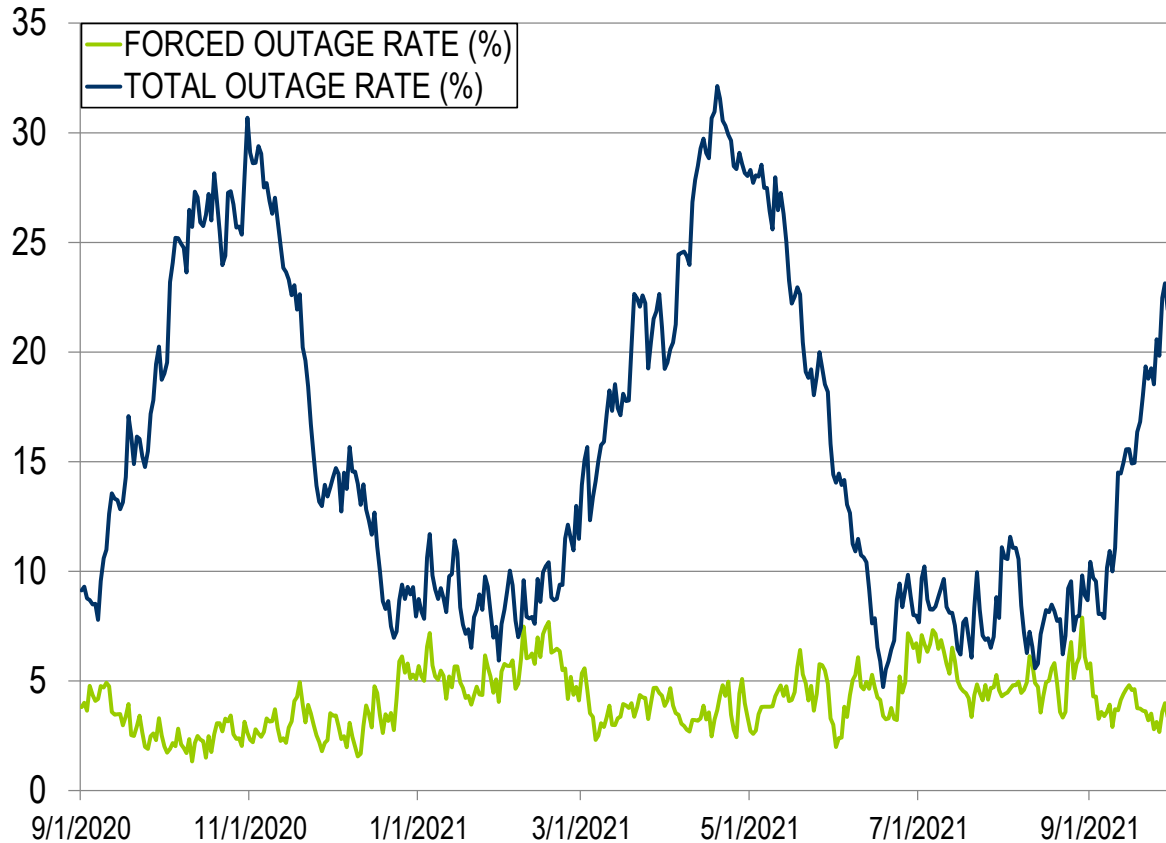

The 13-month average forced outage rate is 4.13% or 8,241 MW.
 The 13-month average total outage rate is 15.44% or 30,718 MW.

PCLLRW Count Vs. Peak Load – Daily Values For 13 Months

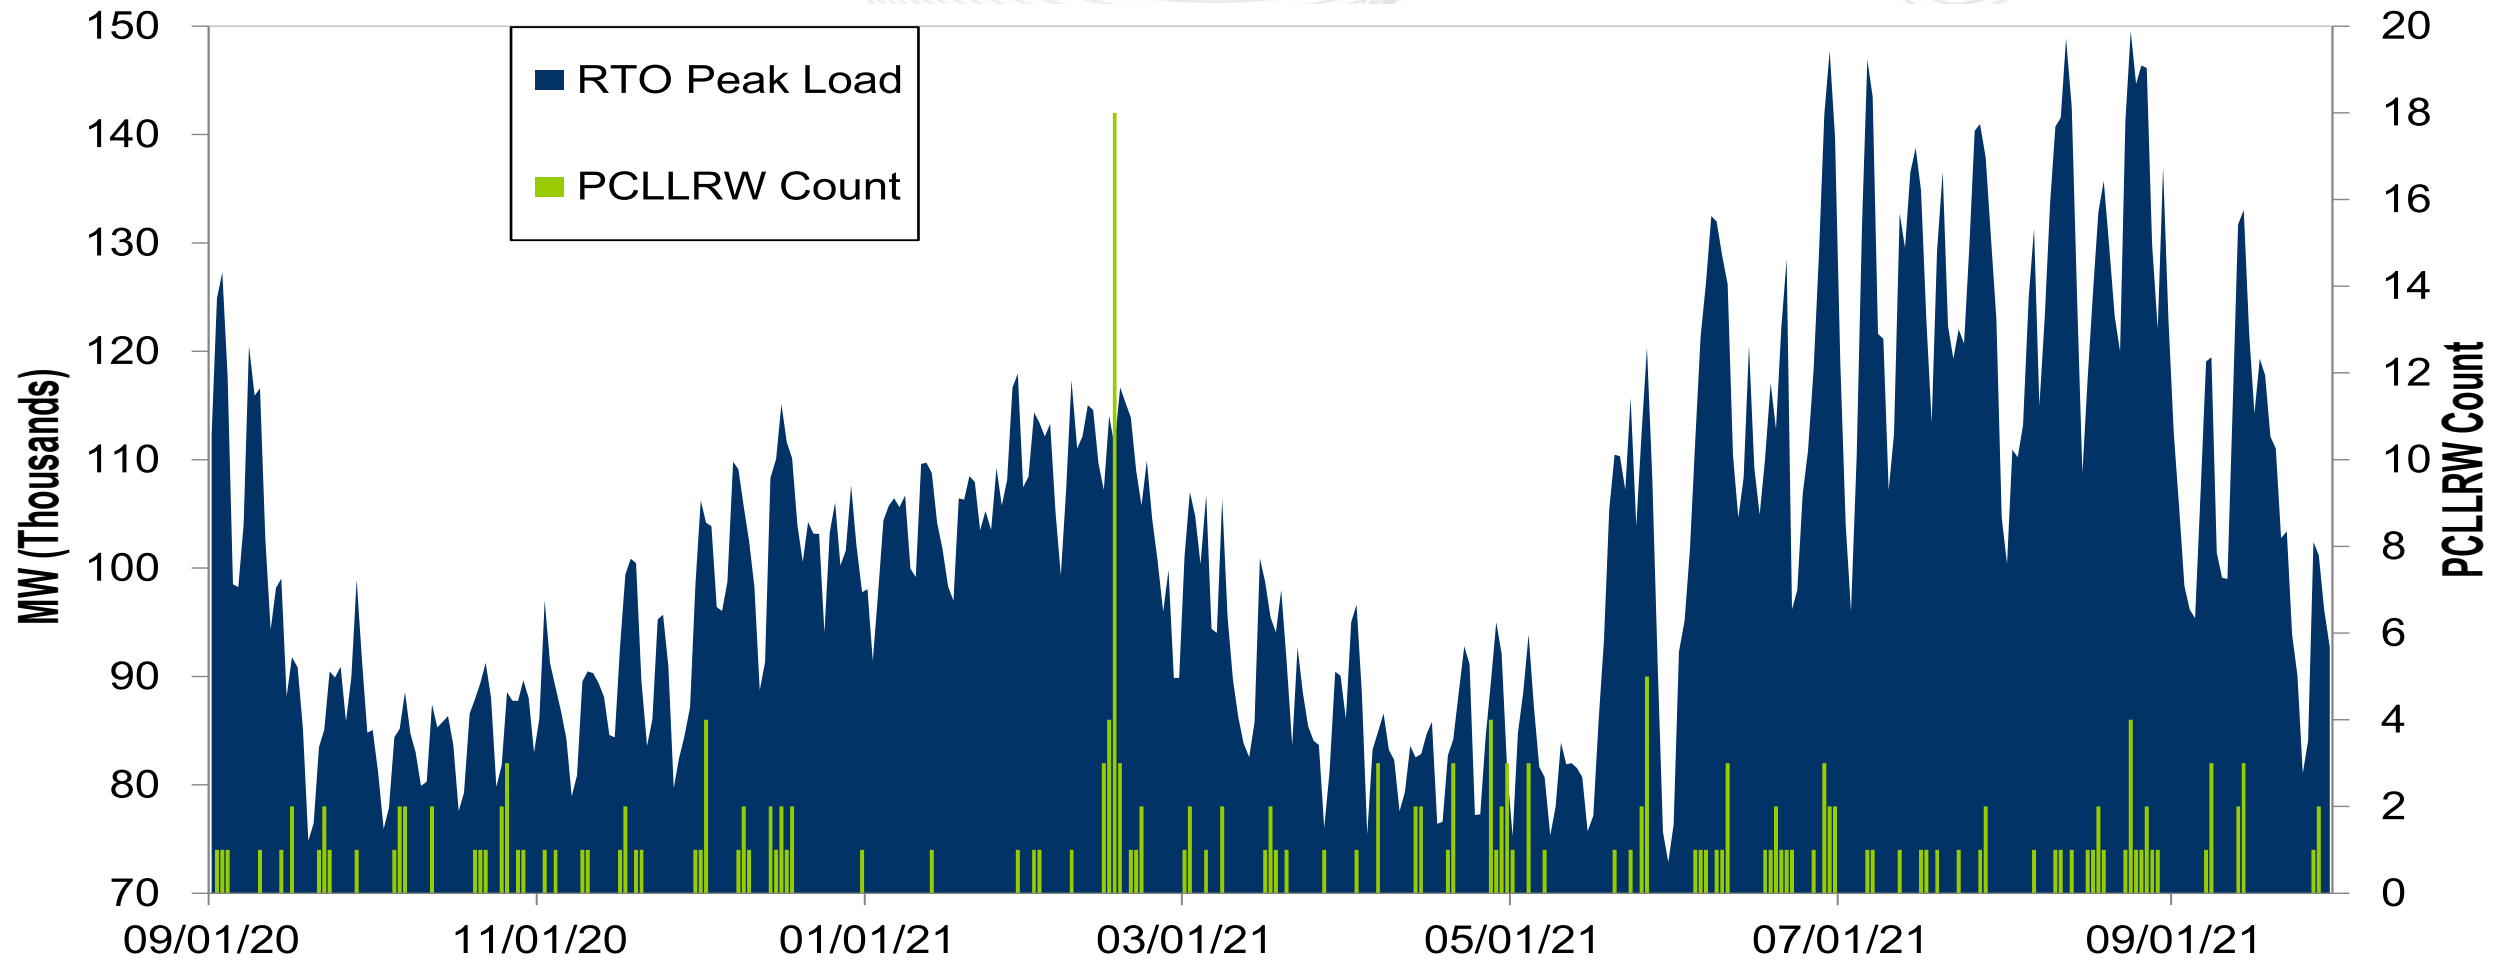

Presenter:
Stephanie Monzon,
Stephanie.Monzon@pjm.com

SME:
David Kimmel,
David.Kimmel@pjm.com

System Operations Report



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com